

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

SPONSOR: **Frasch**
Byhalia, MS

Sound Absorption
RAL™-A23-046

CONDUCTED: 2023-02-22

Page 1 of 10

ON: PIXL Sheets (wall panels)

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-22: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as PIXL Sheets (wall panels). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: PIXL Sheets
Manufacturer: Frasch

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Material: PET felt sheets with PET felt protrusions
Geometry: Eight sheets have six by twelve grid of rounded square protrusions
Two sheets have three by twelve grid of circular protrusions
Dimensions: 8 sheets w square protrusions @ 603 mm (23.75 in.) by 1207 mm (47.5 in.)
2 sheets w circular protrusions @ 298 mm (11.75 in.) by 1207 mm (47.5 in.)
Thickness: Sheets' base felt @ approx. 9.02 mm (0.355 in.)
Total of sheets with square protrusions @ 46.06 mm (1.8135 in.)
Total of sheets with circular protrusions @ 45.54 mm (1.793 in.)

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 2 of 10

Test Specimen (continued)

Protrusion Dimensions: Square protrusions @ 83.21 mm (3.276 in.) by 83.18 mm (3.275 in.)
Circular protrusions @ 83.21 mm (3.276 in.) diameter
Protrusion Spacing: Square protrusions spaced 17.2 mm (0.6755 in.) apart
Circular protrusions spaced 17.3 mm (0.68 in.) apart
Overall Weight: 22.57 kg (49.75 lbs)

Overall Specimen Properties

Size: 2.71 m (106.75 in) wide by 2.41 m (95.0 in) long
Thickness: 0.05 m (1.813 in)
Weight: 22.57 kg (49.75 lbs)
Mass per Unit Area: 3.45 kg/m² (0.71 lbs/ft²)
Calculation Area: 6.543 m² (70.43 ft²)

Test Environment

Room Volume: 291.98 m³
Temperature: 20.0 °C ± 0.1 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)
Relative Humidity: 57.25 % ± 3.9 % (Requirement: ≥ 40 % and ≤ 5 % change)
Barometric Pressure: 97.3 kPa (Requirement not defined)

MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. Perimeter edges were sealed with metal framing and tape.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 3 of 10

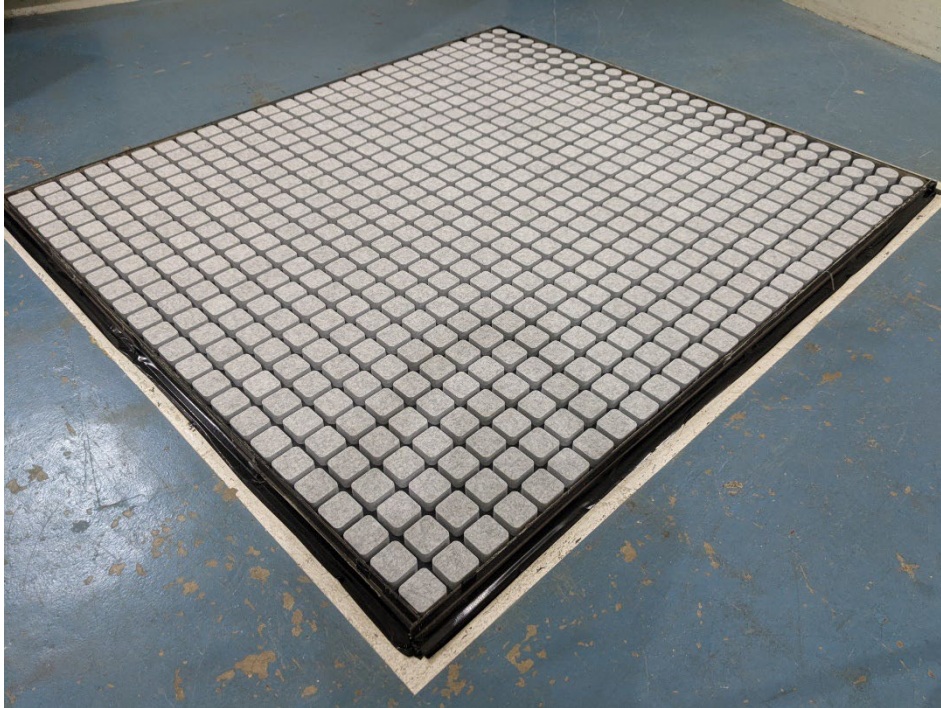


Figure 1 – Specimen mounted in test chamber

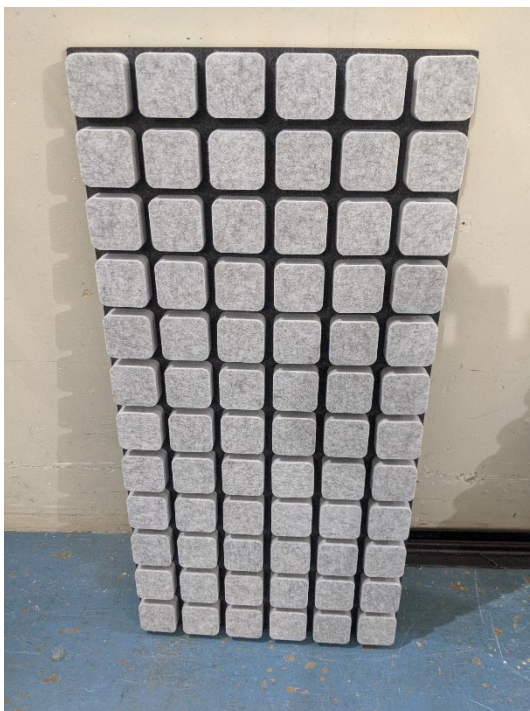


Figure 2 – Individual specimen sheet with square protrusions

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 4 of 10

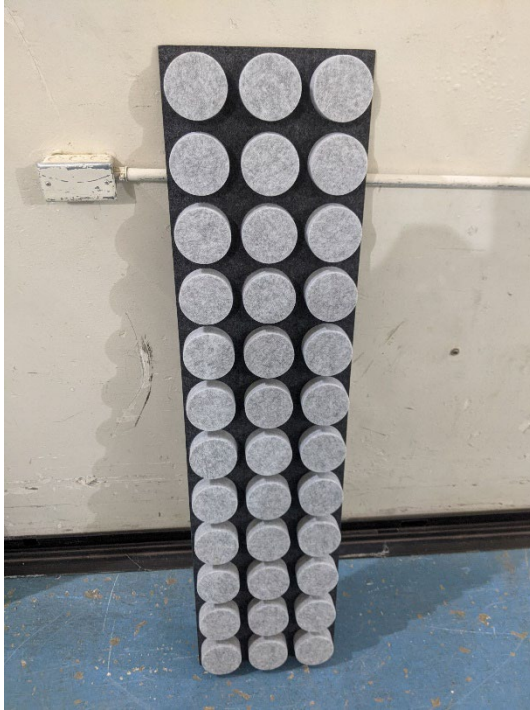


Figure 3 – Individual specimen sheet with circular protrusions



Figure 4 – Detail of specimen materials

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 5 of 10



Figure 5 – Detail of specimen materials

1512 S BATAVIA AVENUE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

Frasch
 2023-02-22

RAL™-A23-046
 Page 6 of 10

TEST RESULTS

Specimen total absorption and absorption coefficient are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages.

1/3 Octave Center Frequency (Hz)	Total Absorption (m ²)	Total Absorption (Sabins)	Absorption Coefficient
100	0.47	5.05	0.07
** 125	0.98	10.52	0.15
160	1.15	12.43	0.18
200	1.63	17.60	0.25
** 250	2.16	23.24	0.33
315	3.49	37.56	0.53
400	4.16	44.76	0.64
** 500	5.20	55.97	0.79
630	5.80	62.45	0.89
800	6.24	67.17	0.95
** 1000	6.29	67.75	0.96
1250	6.50	69.99	0.99
1600	6.61	71.11	1.01
** 2000	6.69	72.06	1.02
2500	6.72	72.37	1.03
3150	6.91	74.39	1.06
** 4000	7.10	76.41	1.08
5000	7.68	82.67	1.17

SAA = 0.78
NRC = 0.80

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 7 of 10


TEST RESULTS (continued)

The sound absorption average (SAA) is defined in ASTM C423-17 Section 3.1.1 as the arithmetic average of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 Hz through 2500 Hz, inclusive, rounded to the nearest integer multiple of 0.01.

The noise reduction coefficient (NRC) is defined from previous versions of ASTM C423 as the arithmetic average of the sound absorption coefficients at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, rounded to the nearest integer multiple of 0.05.

Tested by 
Marc Sciaky
Senior Experimentalist

Report by 
Keith Kimberling
Test Engineer

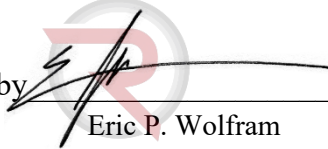Approved by 
Eric P. Wolfram
Laboratory Manager

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report


www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 8 of 10

SOUND ABSORPTION REPORT
PIXL Sheets (wall panels)

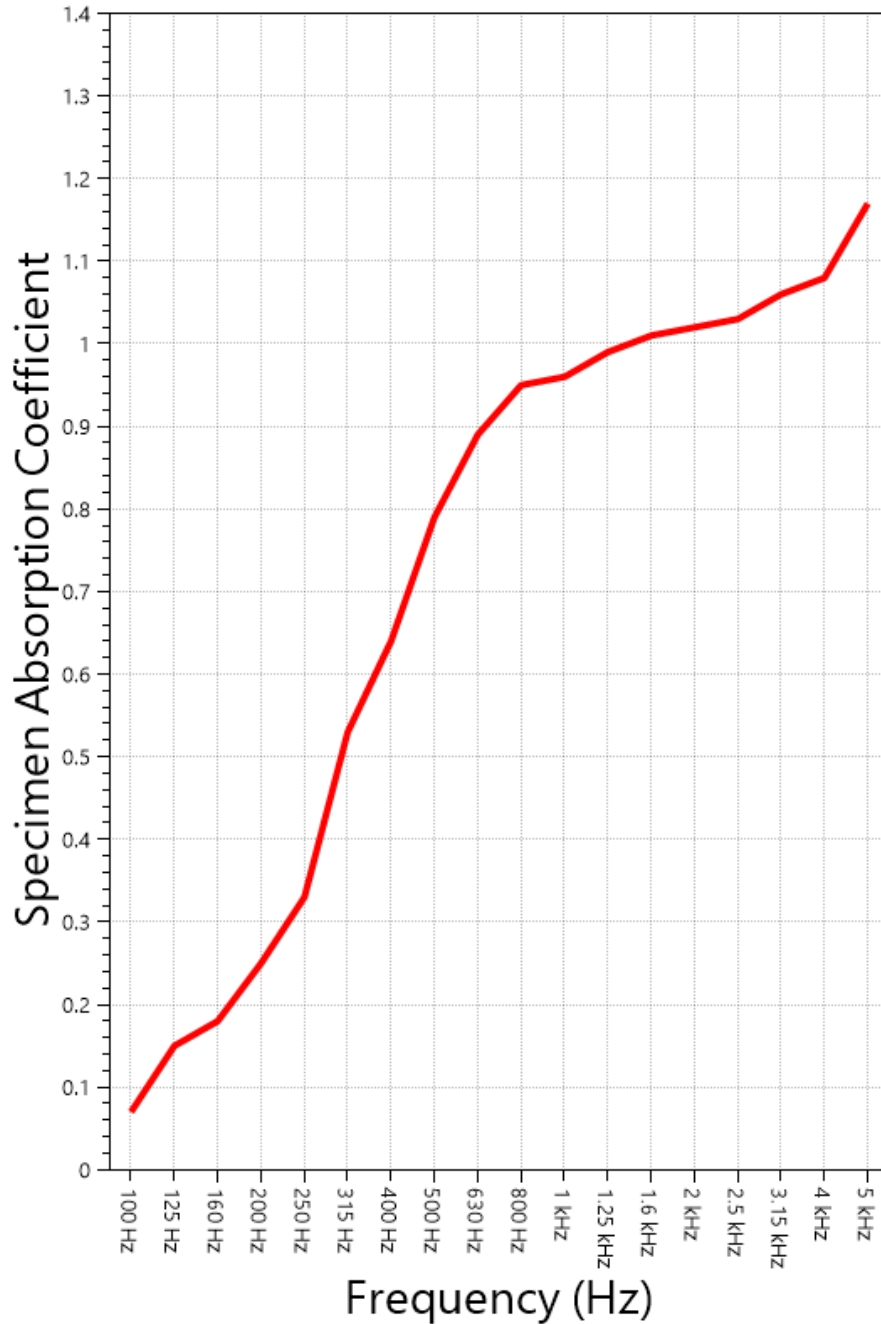

SAA = 0.78
NRC = 0.80



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

Frasch
 2023-02-22

RAL™-A23-046
 Page 9 of 10

APPENDIX A: Extended Frequency Range Data

Specimen: PIXL Sheets (wall panels) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-22, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient
31.5	-9.58	-0.14
40	-11.00	-0.16
50	0.19	0.00
63	2.63	0.04
80	2.94	0.04
100	5.05	0.07
125	10.52	0.15
160	12.43	0.18
200	17.60	0.25
250	23.24	0.33
315	37.56	0.53
400	44.76	0.64
500	55.97	0.79
630	62.45	0.89
800	67.17	0.95
1000	67.75	0.96
1250	69.99	0.99
1600	71.11	1.01
2000	72.06	1.02
2500	72.37	1.03
3150	74.39	1.06
4000	76.41	1.08
5000	82.67	1.17
6300	87.08	1.24
8000	97.66	1.39
10000	104.37	1.48
12500	118.36	1.68

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Frasch
2023-02-22

RAL™-A23-046
Page 10 of 10

APPENDIX B: Instruments of Traceability

Specimen: PIXL Sheets (wall panels) (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160-106968	2022-07-12	2023-07-12
Bruel & Kjaer Mic and Preamp F	Type 4943-B-001	2525857	2023-01-12	2024-01-12
Bruel & Kjaer Pistonphone	Type 4228	2781248	2022-07-22	2023-07-22
EXTECH Hygro 959	SD700	A099959	2022-03-22	2023-03-22

APPENDIX C: Revisions to Original Test Report

Specimen: PIXL Sheets (wall panels) (See Full Report)

<u>Date</u>	<u>Revision</u>
2023-03-03	Original report issued

END